

## Table of Contents

How to use custom input event name .....	1
--	---

# How to use custom input event name


From BioStar 2 V2.7.1, the custom input event name change is supported for easier searching and detecting input events by given names.

It is often used for marking break-glass events and receiving alerts and searching the event by the designated event name.




## How to set?

1. Go to the detailed device setting page, and set 'Trigger & Action'
2. Choose 'Input(Event Name Change)' and enter trigger settings and choose input(event name

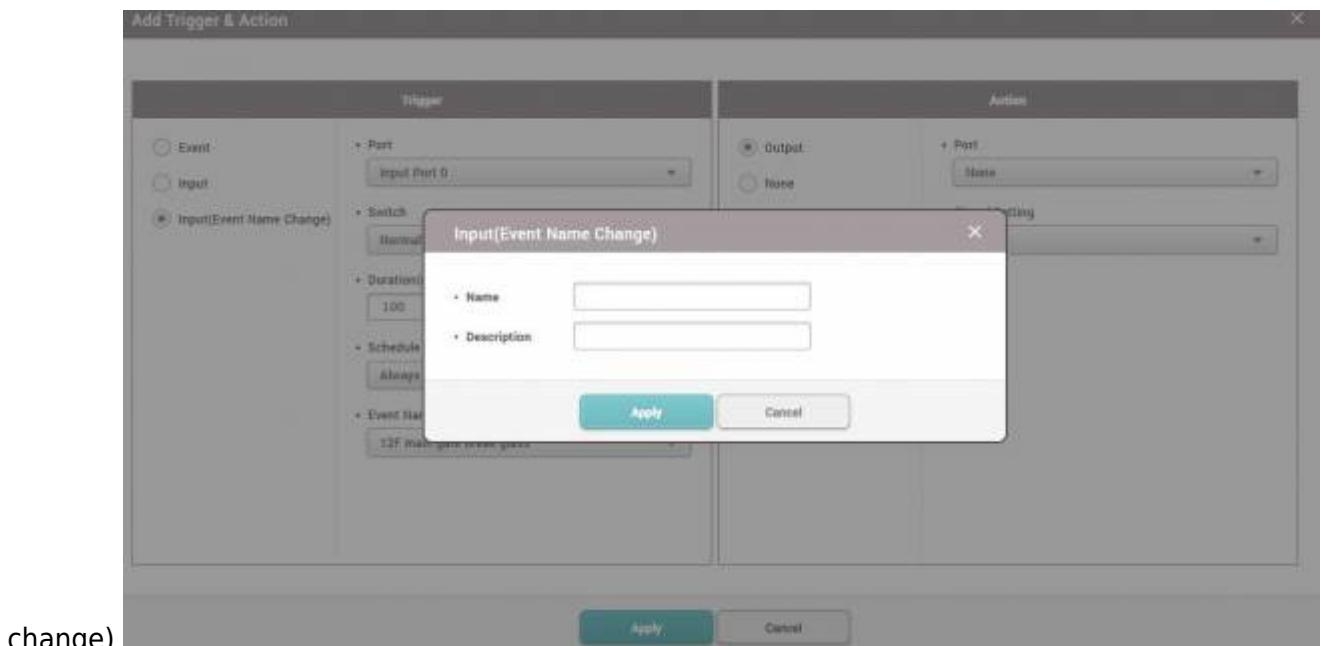

3. Choose 'None' for action when it does not need to output relay signals.

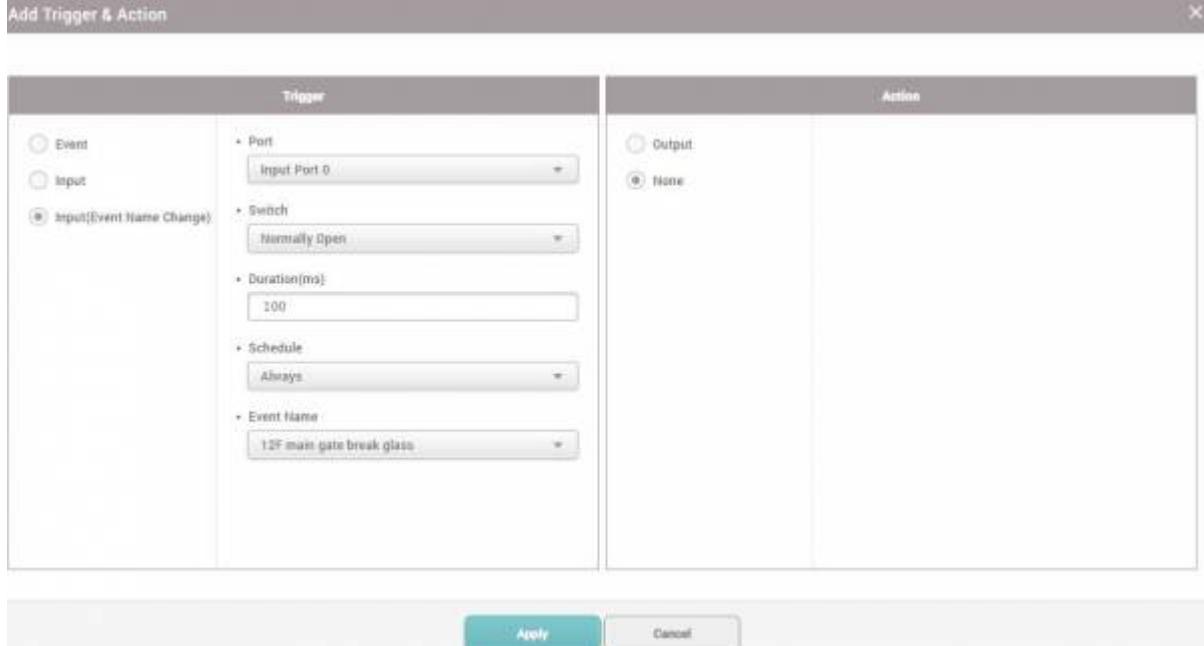

4. Check the monitoring tab to see events and alerts with the custom event names.

**Alert**

Device
<input type="checkbox"/> Device Disconnection Detected
<input type="checkbox"/> Device restarted
<input type="checkbox"/> RS-485 disconnected
<input type="checkbox"/> Tamper on
<input type="checkbox"/> Supervised Input (Short)
<input type="checkbox"/> Supervised Input (Open)
<input type="checkbox"/> AC Power Failure
<input checked="" type="checkbox"/> 12F main gate break glass
<input type="checkbox"/> 14F

01/03 00:00:00

**Event**

- 12F main gate break glass
- Fail to save to the server DB
- Muster zone alarm cleared
- Muster zone alarm detected
- Muster zone time limit violation
- Interlock zone Alarm Clear
- Interlock door open denied alarm (Occupied)
- Interlock door open denied alarm
- Interlock zone alarm

Add Condition Cancel

BioLite N2  
BioEntry V  
BioLite N2  
BioEntry V  
BioEntry V  
BioLite N2  
BioEntry V  
BioLite N2  
BioLite N2  
BioLite N2  
BioLite N2  
BioLite N2

From:  
<http://kb.supremainc.com/knowledge/> -

Permanent link:  
[http://kb.supremainc.com/knowledge/doku.php?id=en:how\\_to\\_configure\\_custom\\_input\\_event\\_name&rev=1639705010](http://kb.supremainc.com/knowledge/doku.php?id=en:how_to_configure_custom_input_event_name&rev=1639705010)

Last update: **2021/12/17 10:36**