


(APB) 1
..... 4


, BioStar 2, APB,

(APB)

가

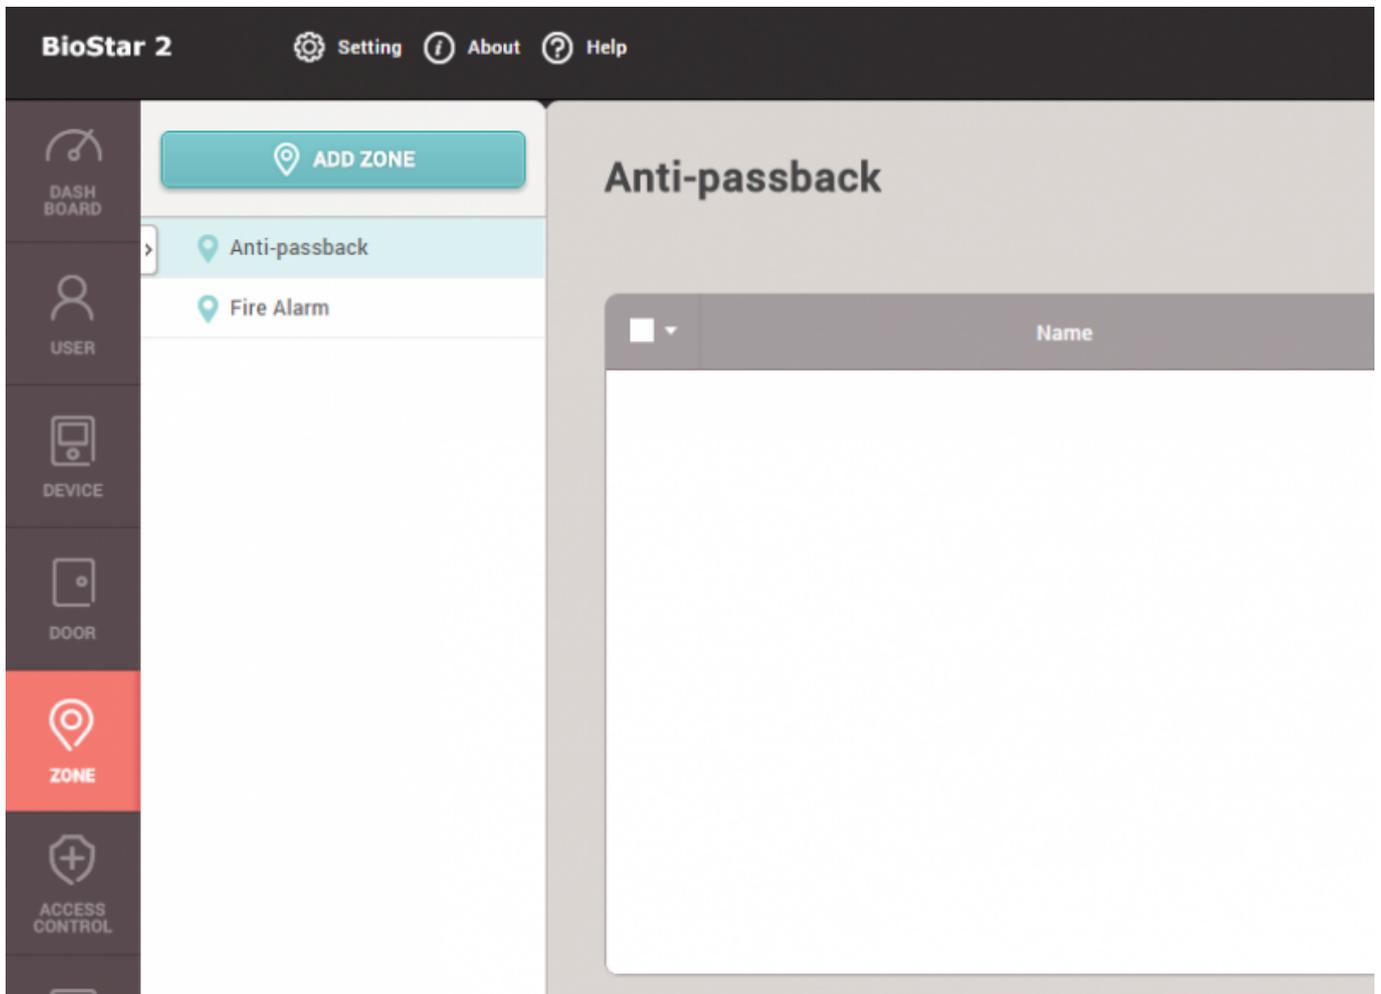

1. 가

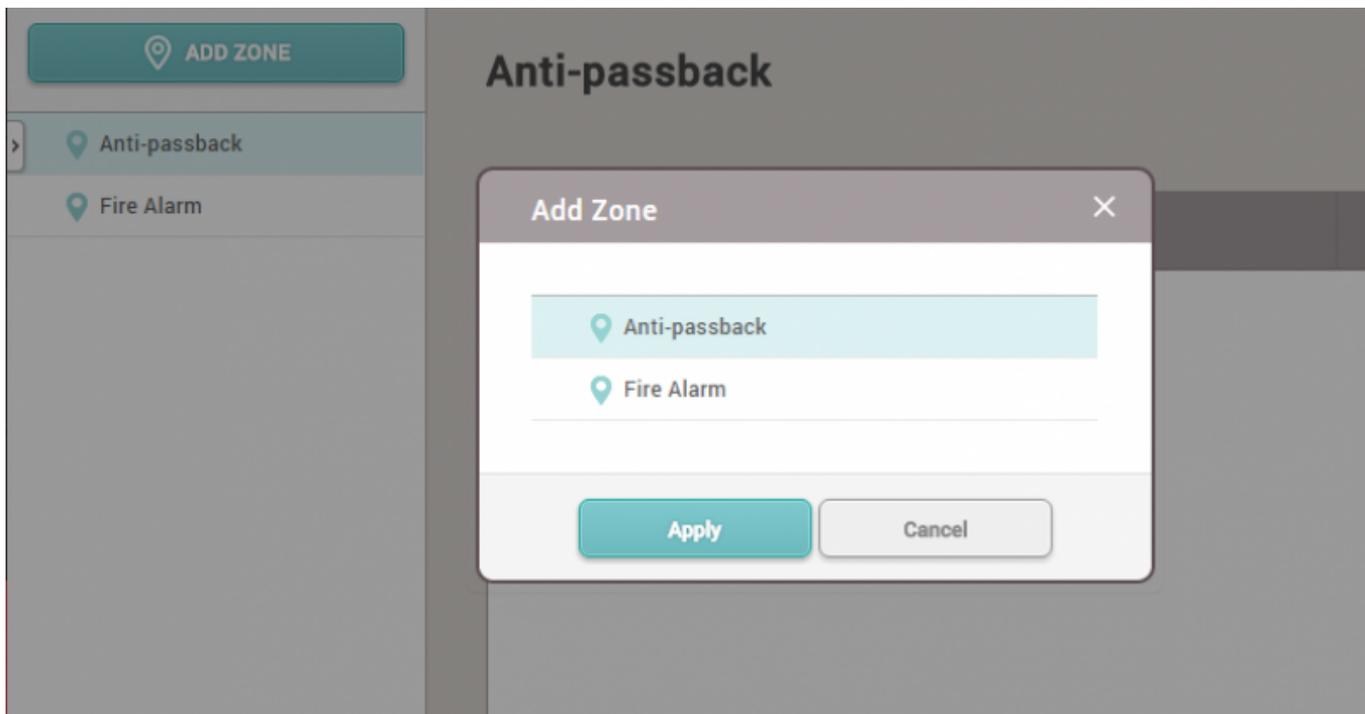


2. APB

. APB




3.

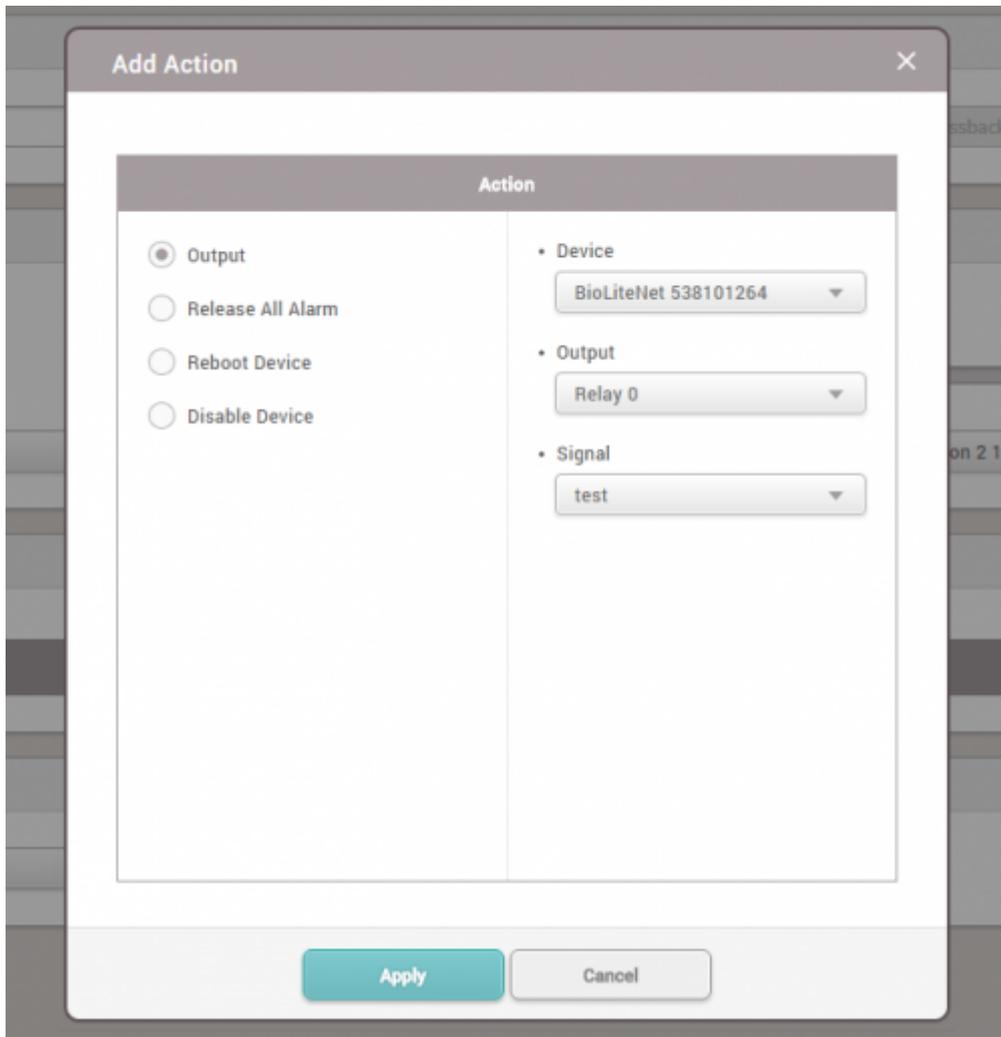

4. APB

APB

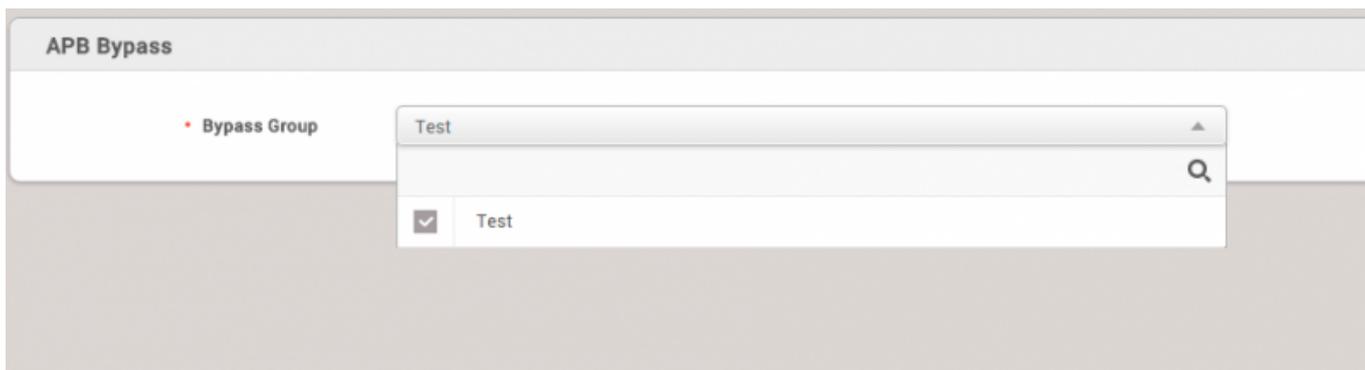

5.

APB

Zone Status

Save Filter

Type	Zone Name	Active/Inactive	Status
Anti-passback	Test	Active	Normal

ACCESS_DENIED_APB

- User: Administrator
- Device: BioStation 2 100000007 (192.168.16.205)
- Alarm: Violation of anti-passback
- Date: 2015/09/16 16:46:18

Comments

Acknowledge Ignore

apb.mp4

From: <http://kb.supremainc.com/knowledge/> -

Permanent link: http://kb.supremainc.com/knowledge/doku.php?id=ko:how_to_configure_apb_zone

Last update: **2017/01/10 13:35**