


Table of Contents

| | |
|---|---|
| The number of access group and access level | 1 |
|---|---|

The number of access group and access level

Before BioStar 2.7.0, BioStar 2 was limited to 128 Access groups and Access levels. From BioStar 2.7.0, BioStar 2 can create access groups and access levels infinitely without any restriction.

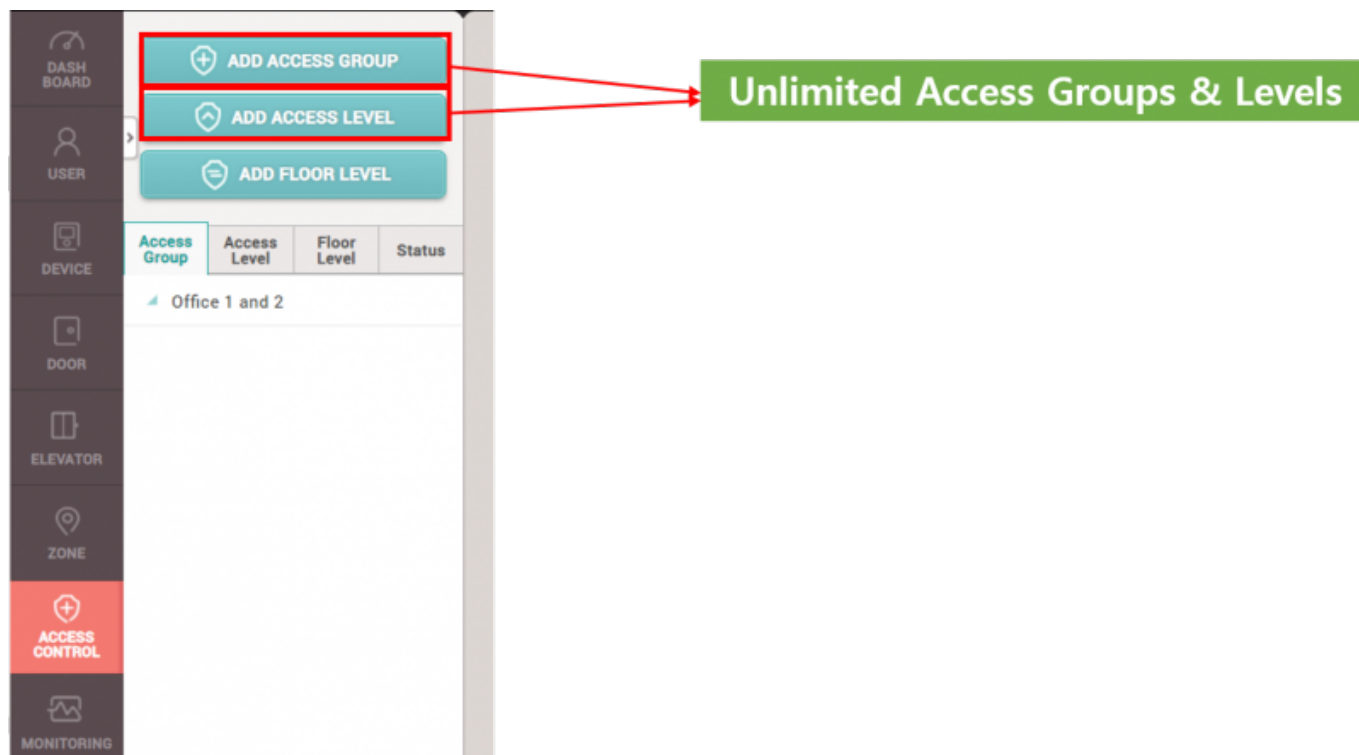

BioStar 2 allows you to create infinite number of Access group, but this number is limited by the device FW's and the number is different for each FW.

FW list which can accommodate up to 2048:

| Model | Version |
|----------------|-----------------|
| BioStation 2 | v1.7.0 or later |
| BioStation A2 | v1.6.0 or later |
| BioStation L2 | v1.4.0 or later |
| BioEntry W2 | v1.3.0 or later |
| FaceStation 2 | v1.2.0 or later |
| CoreStation | v1.2.0 or later |
| BioEntry P2 | v1.2.0 or later |
| BioLite N2 | v1.1.0 or later |
| BioLite | v1.1.0 or later |
| FaceLite | v1.0.0 or later |
| Xpass 2 | v1.1.0 or later |
| FaceStation F2 | v1.0.0 or later |
| X-Station 2 | v1.1.0 or later |

Others including Entry devices with firmware version V2.x can accommodate up to 128 access groups

Sync error occurs when the number of Access Groups for the FW exceeds its limit.

From:
<http://kb.supremainc.com/knowledge/> -

Permanent link:
http://kb.supremainc.com/knowledge/doku.php?id=en:the_number_of_access_group_and_access_level

Last update: **2021/12/29 15:24**