

콘텐츠 테이블

슬레이브 장치에 지문 등록하기 1

예시: 1

시스템 구성, BioStar 2


슬레이브 장치에 지문 등록하기

BioStar 2.5.0부터는 슬레이브 장치에서도 직접 지문을 등록할 수 있습니다.
이것은 지문을 스캔할 장치로 슬레이브 장치를 선택할 수도 있음을 의미합니다.

예시:

- BioStation A2 (id: 541531003) - 마스터 장치
- BioStation L2 (id: 540084005) - 슬레이브 장치

** 마스터 장치는 RS-485 케이블을 통해 슬레이브 장치와 연결됩니다.

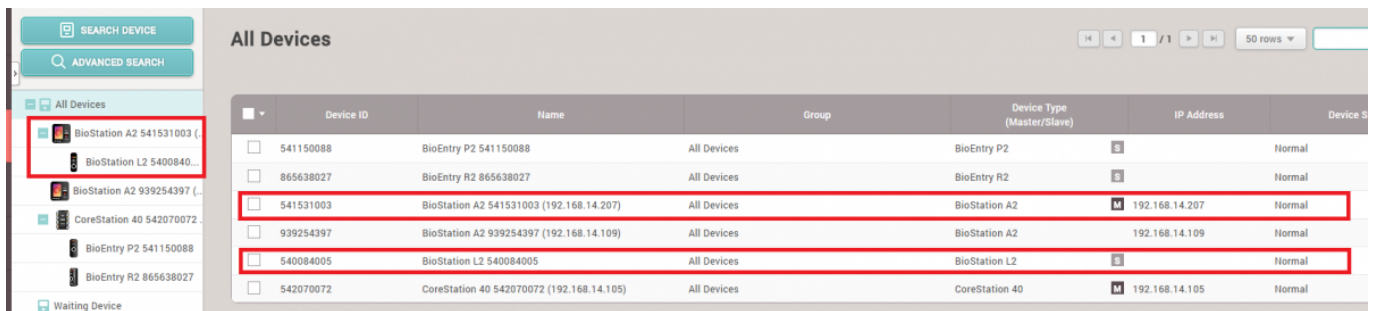

	Device ID	Name	Group	Device Type (Master/Slave)	IP Address	Device S
☐	541150088	BioEntry P2 541150088	All Devices	BioEntry P2	192.168.14.207	Normal
☐	865638027	BioEntry R2 865638027	All Devices	BioEntry R2	192.168.14.207	Normal
☐	541531003	BioStation A2 541531003 (192.168.14.207)	All Devices	BioStation A2	192.168.14.207	Normal
☐	939254397	BioStation A2 939254397 (192.168.14.109)	All Devices	BioStation A2	192.168.14.109	Normal
☐	540084005	BioStation L2 540084005	All Devices	BioStation L2	192.168.14.105	Normal
☐	542070072	CoreStation 40 542070072 (192.168.14.105)	All Devices	CoreStation 40	192.168.14.105	Normal

슬레이브 장치를 선택한 후 지문을 스캔하면 지문 등록이 완료됩니다.

Enroll Fingerprint

• Device

BioStation L2 540084005

• Quality

80



☐ View Image

Enroll Fingerprint

1st

2nd

+ Add



Scan

Delete

Validate

☐ Duress

Enroll

Cancel

- BioLite Net은 본 기능을 지원하지 않습니다.

From:

<http://kb.supremainc.com/knowledge/> -

Permanent link:

http://kb.supremainc.com/knowledge/doku.php?id=ko:fingerprint_enrollment_on_the_slave_device

Last update: **2020/03/31 17:13**