

	(Daylight Saving Time)	1
BioStar 2		1
BioStar 2		3
		4

[BioStar 2](#),[Daylight Saving Time](#), [DST](#)

(Daylight Saving Time)

(Daylight Saving Time)

BioStar 2

: BioStar 2.6.0


:

Device	Version
BioStation 2	V1.5.0 or above
BioStation A2	V1.4.0 or above
CoreStation	V1.1.0 or above
BioEntry P2	V1.1.0 or above
BioStation L2	V1.3.0 or above
BioEntry N2	V1.0.0 or above
BioEntry W2	V1.2.0 or above
FaceStation 2	V1.1.0 or above



* Entry device which firmware version is V2.x is not supported

BioStar 2

1. (Settings) > (DAYLIGHT SAVING TIME) .

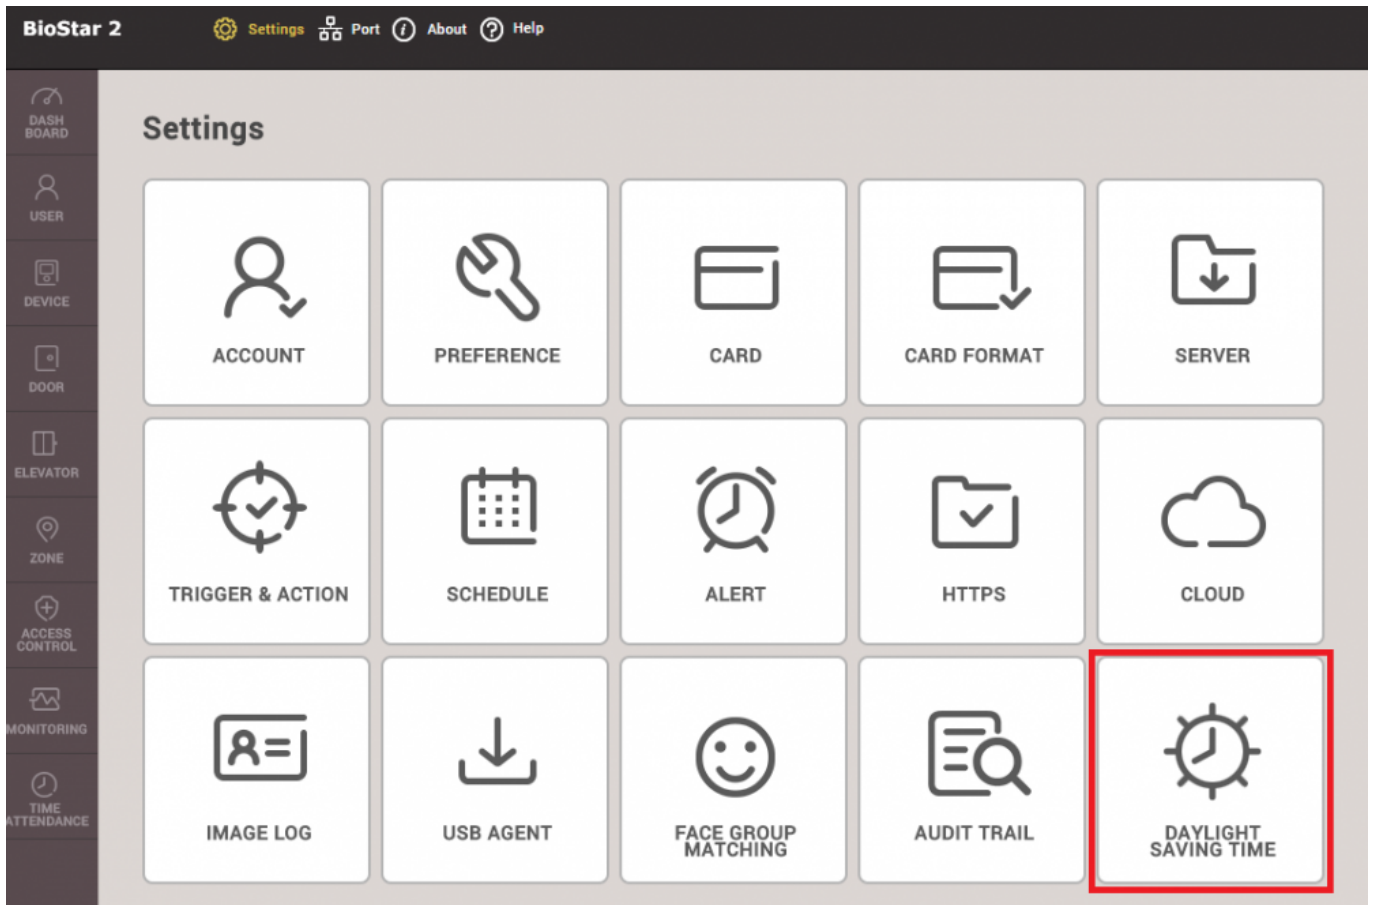


2. + 가(+Add)

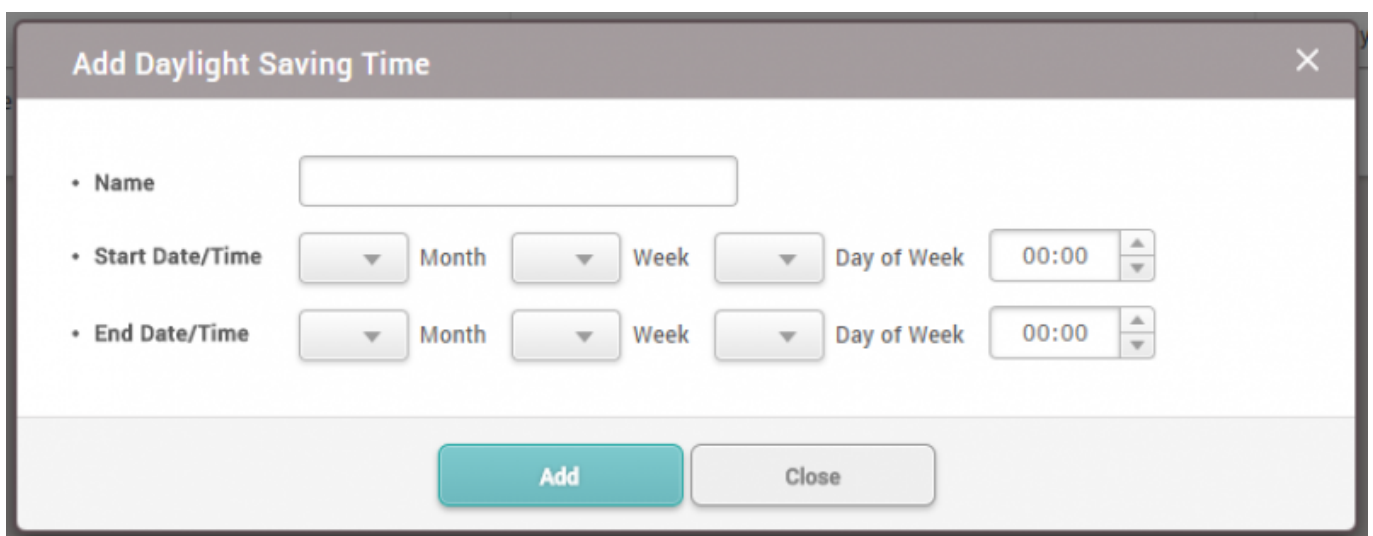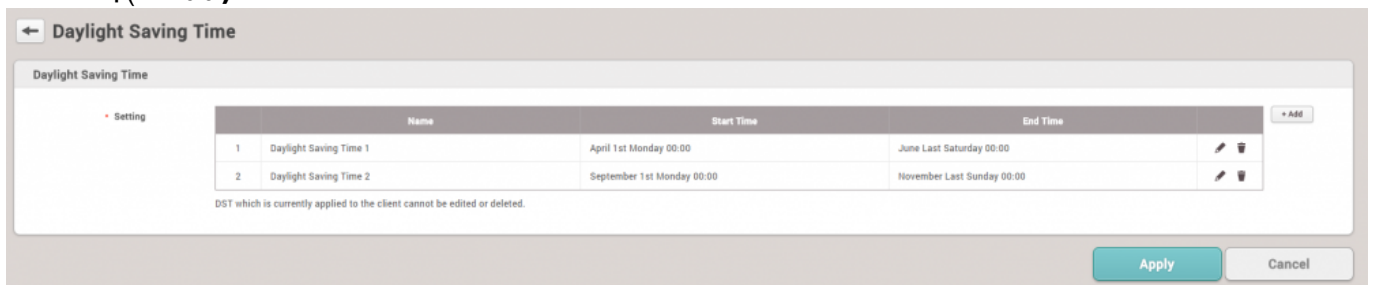


- 가 : 200
- : 48

BioStar 2

1. (Settings) > (PREFERENCE)

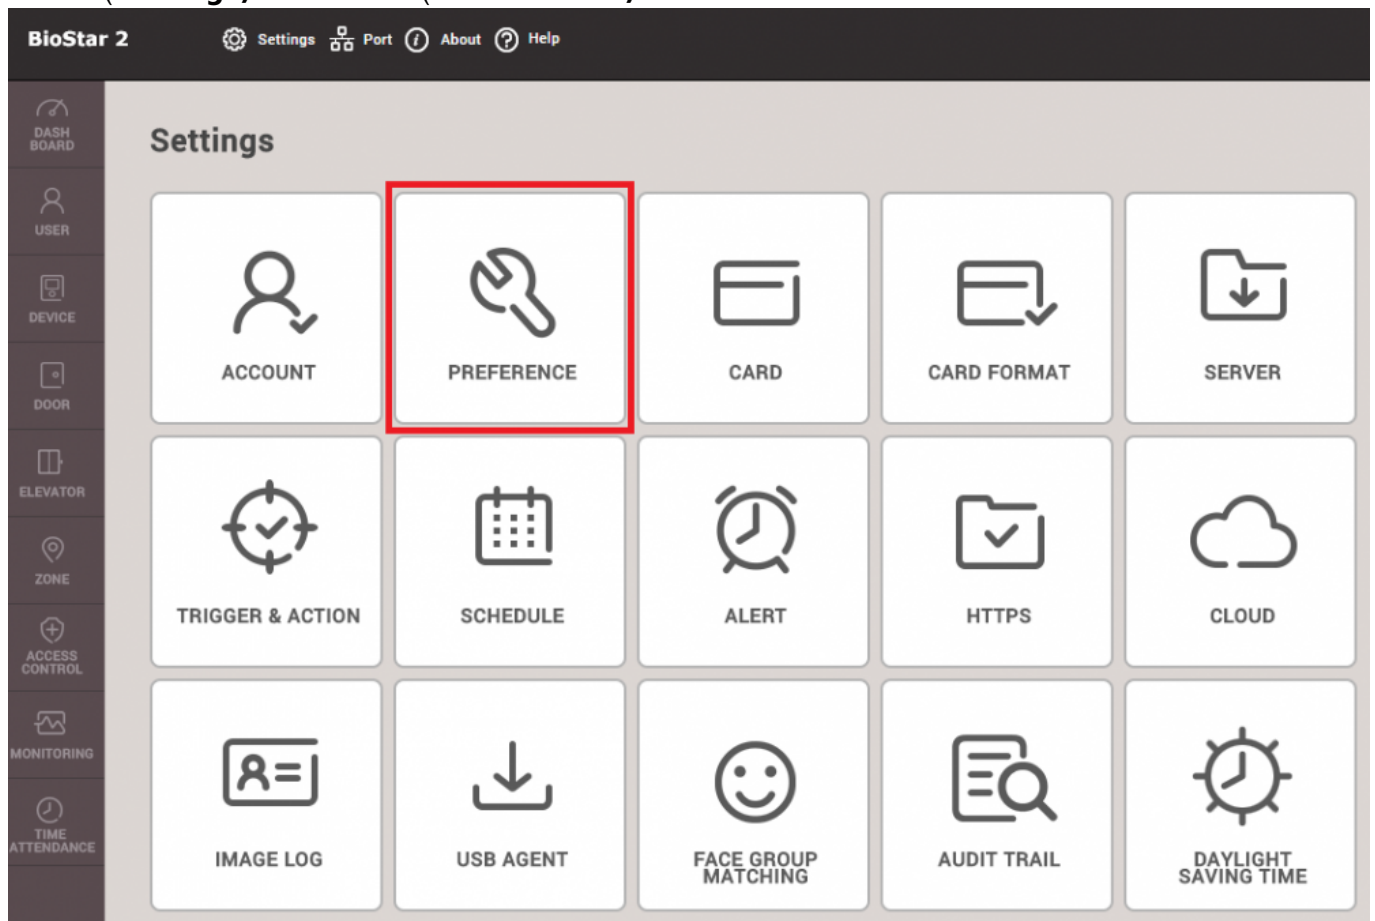


2. 2

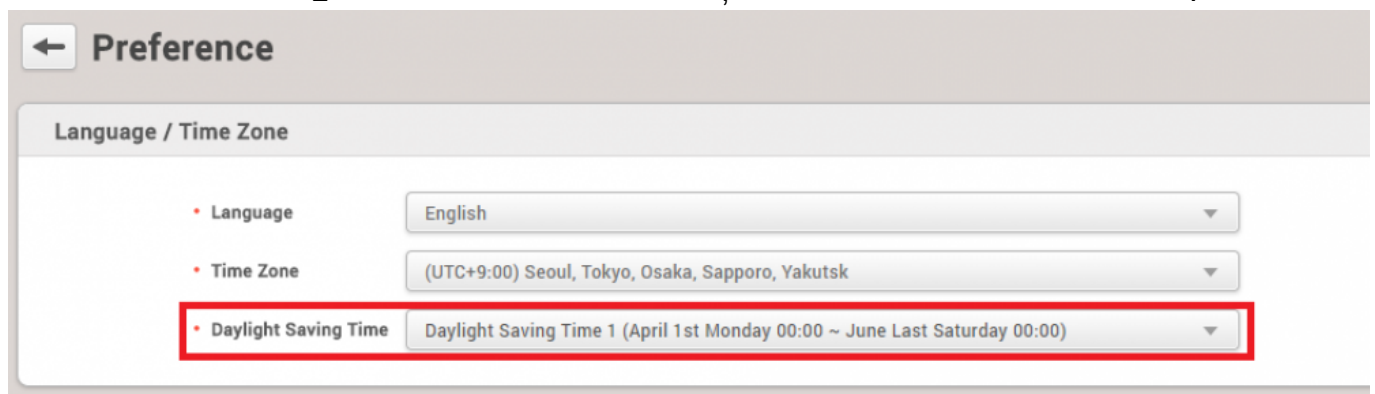

- BioStar 2 (Settings) > (PREFERENCE) 가
- BioStar 2 ((Settings) > (PREFERENCE)) (Setting) > (DAYLIGHT SAVING TIME)

3. ()
+ 1 .

- BioStar 2 ,
1. BioStar 2 .
 2. (Daylight Saving Time) . 2

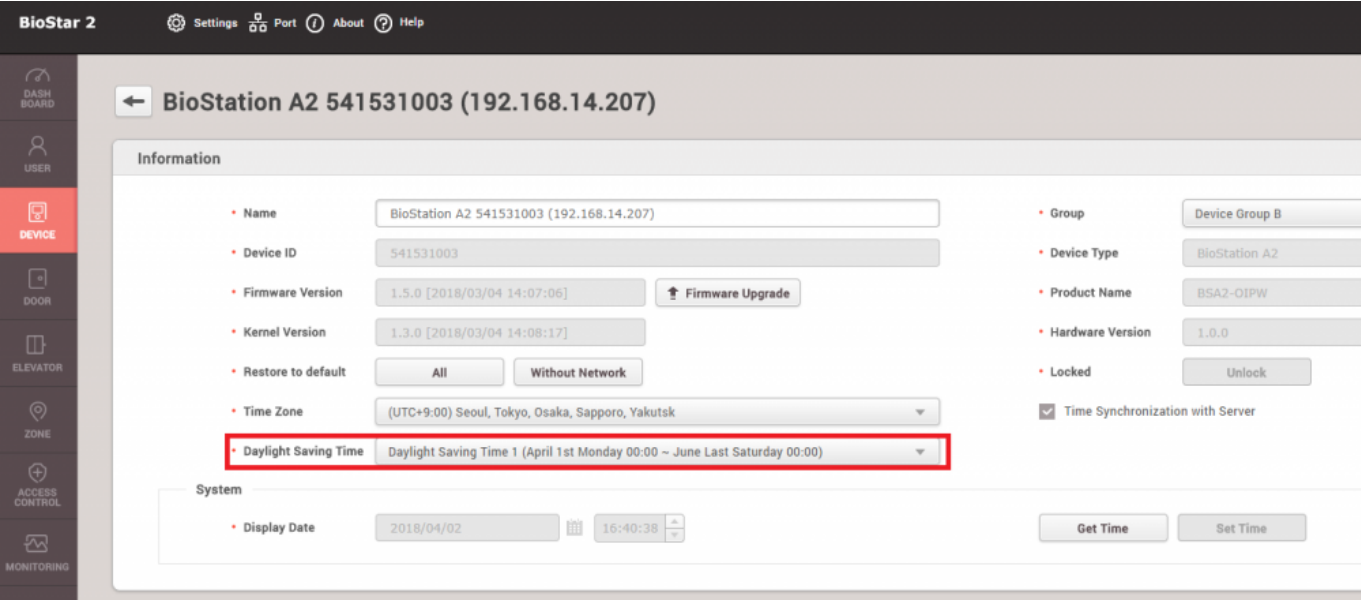

- , BioStar 2
(Settings) > (DAYLIGHT SAVING TIME)
- () 2
-
- UTC-0 . UTC, ,

1. ,
2. > .
3. 1, 2
4. 1 2가 1 .

From:

<http://kb.supremainc.com/knowledge/> -

Permanent link:

http://kb.supremainc.com/knowledge/doku.php?id=ko:how_to_configure_daylight_saving_time

Last update: **2018/07/10 14:14**