

(TLS/SSL)	1
.....	1
.....	2

, BioStar 2, TLS,

(TLS/SSL)

(TLS: Transport Layer Security / SSL:Secure Sockets


Layer)

BioStar 2.4

가

IP가

가

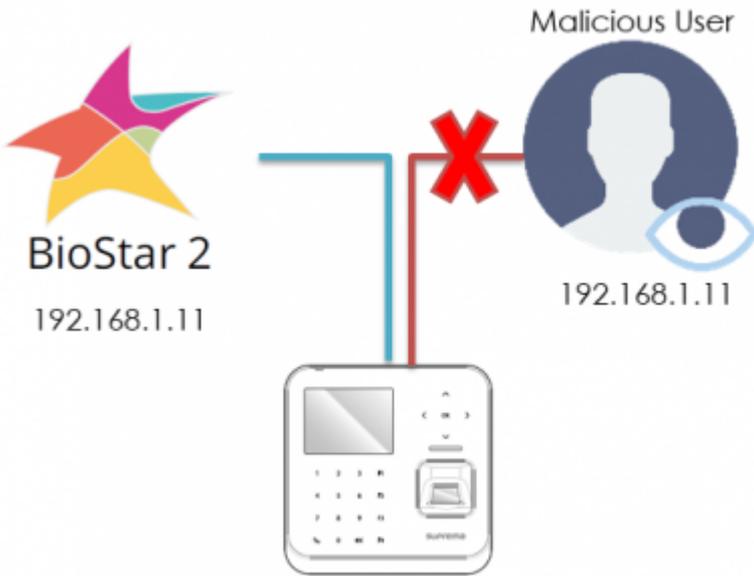


1)

가

()

ID

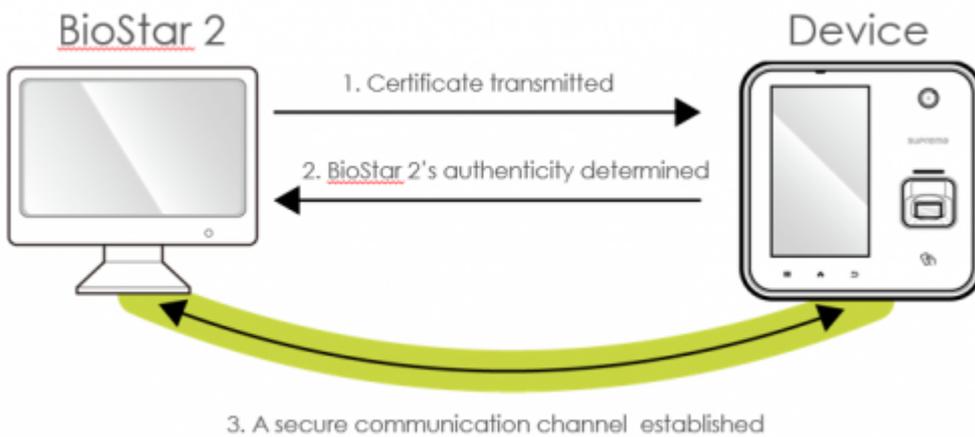

가

/

- BioEntry W2 FW 1.1.0
- BioStation L2 FW 1.2.0
- BioStation A2 FW 1.3.0
- BioStation 2 FW 1.4.0
- FaceStation 2 FW 1.1.0
- CoreStation FW 1.0.0
- BioEntry P2 FW 1.0.0

1. BioStar 2
2. (Setting)
3. (SERVER)
4. (Secure Communication with device) (Secure communication with device) (Use)

VeriSign, Comodo, GoDaddy CA() (Use external certificates) (Upload)

Secure Communication with Device

<ul style="list-style-type: none"> • Secure communication with device <input checked="" type="checkbox"/> Use • Root certificate <input type="button" value="Upload"/> • Private key <input type="button" value="Upload"/> 	<ul style="list-style-type: none"> • Use external certificates <input checked="" type="checkbox"/> Use • Public key certificate <input type="button" value="Upload"/> • Private key passphrase (Optional) <input type="text"/> • Confirm private key passphrase <input type="text"/>
---	--

, BioStar 2 가

BioEntry W2 BioEntry P2 LCD가

FAQ : [Factory Default W2 / P2](#)

1)

icon designed by Madebyoliver from Flaticon

From:

<https://kb.supremainc.com/knowledge/> -

Permanent link:

https://kb.supremainc.com/knowledge/doku.php?id=ko:how_to_configure_secure_communication_between_device_and_server_tls_ssl

Last update: **2018/07/24 10:57**