

..... 1

가 , FaceStation 2 1:N 가 , 3,000 가 , BioStar 2 가 가 .




⚠ Sync error occurs when data exceeds device capacity.
However, many users do not know why a sync error occurs.

, BioStar 2.7.0 , , 가

가

- BioStation 2: 1.7.0
- BioStation A2: 1.6.0
- BioStation L2: 1.4.0
- BioEntry W2: 1.3.0
- FaceStation 2: 1.2.0
- CoreStation: 1.2.0
- BioEntry P2: 1.2.0
- BioLite N2: 1.1.0
- FaceLite: 1.0.0

- V2.x가 Entry .

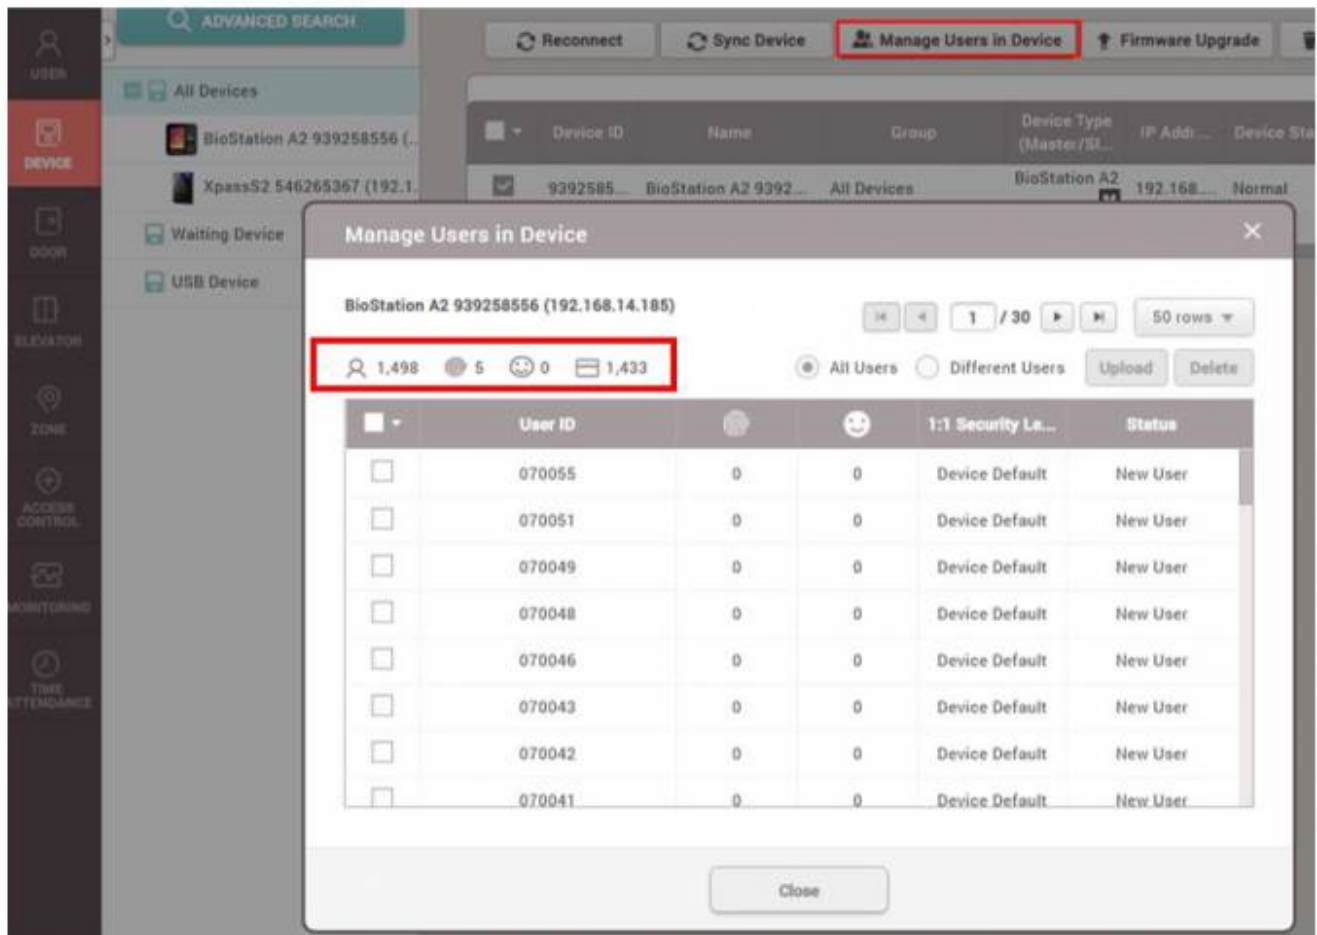

From:

<http://kb.supremainc.com/knowledge/> -

Permanent link:

http://kb.supremainc.com/knowledge/doku.php?id=ko:manage_users_in_device_overview

Last update: **2020/05/18 18:48**